



## Cooling Tower Compliance and Operational Inspections

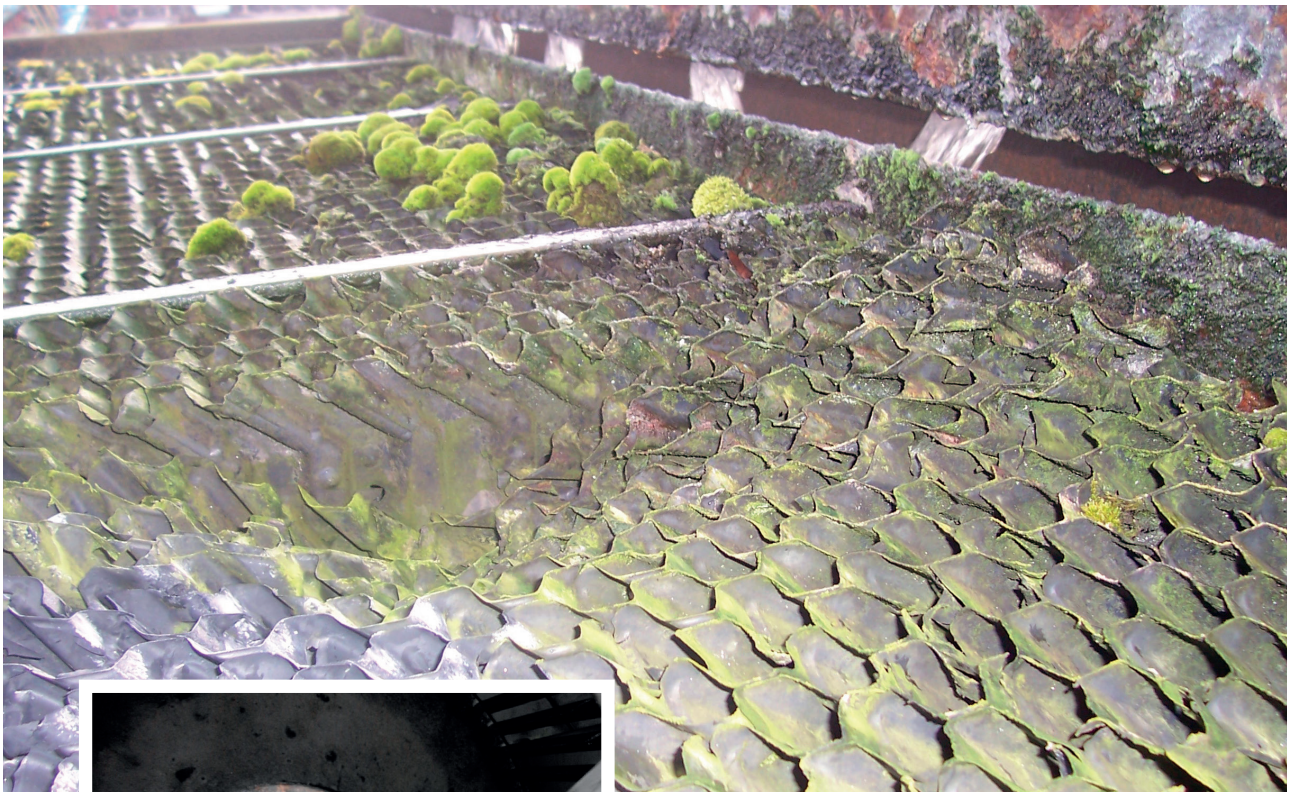

It is essential to ensure evaporative cooling towers and condensers are correctly and professionally maintained for safe, efficient and compliant operation (HSE L8:2013, HSG 274 Part 1 and CIBSE TM13:2013). Tower Systems offer a nationwide specialised inspection service.

- Tower Systems specialist surveyors
- Component by component inspection
- Mechanical and operational condition
- Current Regulation/recommendation compliance observations
- Free of charge inspections

For further information or to arrange a visit please contact us on 01923 238603.

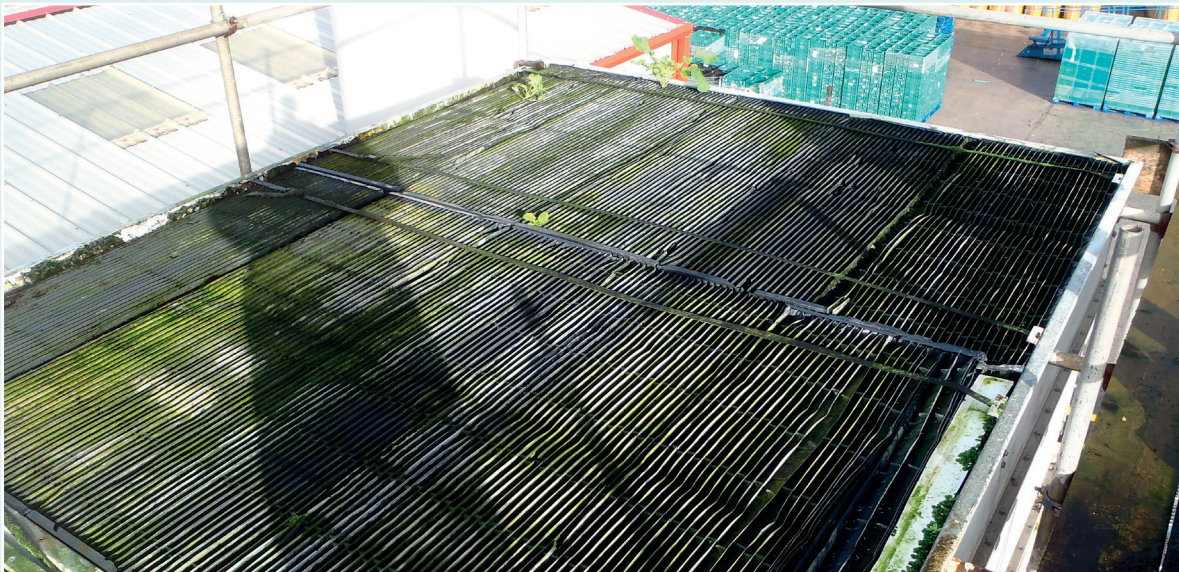

Each inspection report consists of the following sections (where applicable) including photographic support as required:

- Overview
- External condition
- Internal Condition
- Make-up assembly
- Pan strainer
- Heater package
- Air inlet louvres
- Access doors and gaskets
- Fan set and motor
- Leaks
- Water distribution system and heat transfer surface (fill pack and/or coil)
- Drift eliminators
- Conclusion

